



Minnesota Pollution Control Agency

Duluth Office | 525 Lake Avenue South | Suite 400 | Duluth, MN 55802 | 218-723-4660

800-657-3864 | 651-282-5332 TTY | www.pca.state.mn.us | Equal Opportunity Employer

March 29, 2012

The Honorable Kate Stuart
Mayor, City of Nerstrand
P.O. Box 161
Nerstrand, MN 55053-0161

RE: Final Reissued NPDES/SDS Permit No. MN0065668
Nerstrand Wastewater Treatment Facility
T110N, R19W, Section 14, Nerstrand, Rice County, Minnesota

Dear Mayor Stuart:

Enclosed is the final National Pollutant Discharge Elimination System (NPDES)/State Disposal System (SDS) permit for your wastewater treatment facility (WWTF). This permit supersedes an earlier NPDES/SDS permit that was issued on March 12, 2007. No written comments were received during the public notice comment period for the draft permit.

It is the responsibility of the Permittee to maintain compliance with all of the terms and conditions of this permit. Please carefully review the entire permit. A "Submittals and Actions Checklist" that is specific for your facility is also enclosed for your use. You may find this checklist to be a convenient tool in tracking the due dates and status of submittals required by the final issued permit.

Special attention should be directed to the following:

Limits and Monitoring Requirements

Dissolved Oxygen Limit/Surface Water Monitoring – In reviewing the dissolved oxygen effluent data from your WWTF, the average effluent concentration of dissolved oxygen was 5.14 mg/L with the highest and lowest concentration of 6 mg/L and 5 mg/L respectively. Comparing the effluent data with the surface water monitoring data indicates that the effluent is not adversely impacting the dissolved oxygen in the receiving water. The dissolved oxygen variance has been removed as a permit condition, dissolved oxygen monitoring is required two/month, and the surface water monitoring has been removed from the permit.

Flow Monitoring on Discharge Monitoring Reports (DMRs) – WWTF flow monitoring data will now be reported on the effluent DMR (SD001) rather than the influent DMR (WS001). If the WWTF has the capability of measuring both influent and effluent flow, flow monitoring will be required on both DMRs. The Permittee does not have to install an effluent flow meter if the WWTF does not have one currently.

Salty Discharge Requirements - Because your WWTF has a receiving water stream flow to effluent dilution ratio of less than 5:1, the MPCA is requiring that your WWTF monitor for salty discharge parameters. Monitoring of Bicarbonates, Calcium, Chloride, Hardness, Magnesium, Potassium, Sodium, Dissolved Solids, Specific Conductance, and Sulfate shall be sampled quarterly from the effluent waste stream (SD001). Monitoring data will be recorded on a custom supplemental form provided by the MPCA.

The form must be submitted with your monthly DMR. A copy of the custom supplemental form is included with the permit. Please review Chapter 2, Surface Discharge Stations - Special Requirements and the limits and monitoring requirements section of the Permit carefully.

Nitrogen, Nitrate Monitoring - There is a new nitrate impairment listing (2010 303(d) list) for the Little Cannon River approximately 10 miles downstream of the WWTF. Due to this impairment listing you are required to monitor for Nitrogen, Nitrate once/month at the SD station. The MPCA strongly suggests that you work to reduce influent nitrogen by identifying and removing sources of Nitrogen into the wastestream.

Chapter 2. Surface Discharge Stations

Special Requirements for Salty Discharges - Please review Sections 2.1 through 2.3 of this Chapter carefully. The Permittee may request a reduction in monitoring if, after two years of data, the monitoring does not indicate a reasonable potential to exceed a limit. If monitoring results indicate a reasonable potential for any of the parameters, the Permittee will be required to submit an application for permit modification and, if necessary, a compliance schedule will be added to the Permit to ensure progress towards meeting the water quality standards.

Chapter 3. Phosphorus Management Plan

Phosphorus. Phosphorus is a common constituent in many wastewater discharges and a pollutant that has the potential to negatively impact the quality of Minnesota's lakes, wetlands, rivers, and streams. Phosphorus promotes algae and aquatic plant growth often resulting in decreased water clarity and oxygen levels. In addition to creating general aesthetic problems, these conditions can also impact a water body's ability to support healthy fish and other aquatic species. Therefore, phosphorus discharges are being carefully evaluated throughout the state:

You are required to prepare a Phosphorus Management Plan (PMP) and submit it to the MPCA within 180 days of permit expiration. While the PMP does not require specific reductions at this time, the MPCA strongly encourages you to identify and eliminate/reduce sources of phosphorus to, and improve phosphorus management within, your wastewater treatment facility. However, you should be aware that new or expanding discharges may be required to actively manage and reduce phosphorus, including complying with new or more restrictive phosphorus effluent limits. Please review these permit requirements carefully.

Guidance for considering phosphorus in your wastewater treatment system and preparing a PMP has been included with this permit. You can also find information on the web at:

<http://www.pca.state.mn.us/water/pmp.html> or

<http://mntap.umn.edu/potw/phosphorusresources.htm>. For additional information about completing the PMP, please contact the MPCA at 651-282-6143 or 800-657-3864.

Chapter 6. Domestic Wastewater – Septage (analyzed)

This permit chapter requires biosolids to be treated to meet specific standards, and specifies monitoring, recordkeeping, reporting, and general requirements for biosolids that are applied to the land. Unless they are exceptional quality biosolids, sites to which biosolids are applied are approved by the MPCA by the procedures found in Minn. R. 7041.0800.

The Honorable Kate Stuart

Page 3

March 29, 2012

Chapter 7. Pretreatment

New state pretreatment rules, Minn. Rules, Chapter 7049, are now effective and their requirements are incorporated into this chapter. Please review these permit requirements carefully.

Total Maximum Daily Load (TMDL) Study: To address water quality impairments, a TMDL study of the Little Cannon River watershed may be conducted. The study will determine the capacity to assimilate pollutant loads as the basis for recommendations of wasteload allocation for point sources and load allocation for nonpoint sources within the watershed. An appropriate balance of point and nonpoint source controls that attain water quality objectives will be selected with full stakeholder involvement. Based on the results of the TMDL study, the permit may be reopened and effluent limitations for this facility may be re-examined. This permit will be modified or reissued as needed to incorporate effluent loading recommendations from the TMDL study.

Electronic Discharge Monitoring Reports (e-DMRs). Discharge Monitoring Reports can now be completed, signed and submitted electronically using MPCA's Online Services. To begin using the e-DMRs, go to: <https://netweb.pca.state.mn.us/private/>.

Questions about your permit should be directed to the appropriate staff contacts listed on the first page of your permit.

Sincerely,



Nicole Blasing
Pollution Control Specialist
Municipal Wastewater Section
Municipal Division

NB:slm

Enclosures Final NPDES/SDS Permit
 Submittals and Actions Checklist
 Custom Supplemental Report Form

cc: Steven P. McDowell, Water/Sewer Commissioner, Nerstrand (w/enclosures)
Doreen Quistorff, City Clerk, Nerstrand (w/enclosures)
MPCA Rochester Regional File



STATE OF MINNESOTA

Minnesota Pollution Control Agency

Municipal Division

National Pollutant Discharge Elimination System (NPDES)/
State Disposal System (SDS) Permit MN0065668

PERMITTEE: The City of Nerstrand
FACILITY NAME: Nerstrand Wastewater Treatment Facility
RECEIVING WATER: Unnamed ditch (Class 2B,3C,4A,4B,5,6 water) to the Little Cannon River

CITY: Nerstrand

COUNTY: Rice

ISSUANCE DATE: March 29, 2012

EXPIRATION DATE: February 28, 2017

The state of Minnesota, on behalf of its citizens through the Minnesota Pollution Control Agency (MPCA), authorizes the Permittee to operate a disposal system at the facility named above and to discharge from this facility to the receiving water named above, in accordance with the requirements of this permit.

The goal of this permit is to reduce pollutant levels in point source discharges and protect water quality in accordance with Minnesota and US statutes and rules, including Minn. Stat. chs. 115 and 116, Minn. R. chs. 7001, 7049, 7050, 7053, 7060, and the US Clean Water Act.

This permit is effective on the issuance date identified above, and supersedes the previous permit that was issued for this facility on March 12, 2007. This permit expires at midnight on the expiration date identified above.

Signature: _____

Aaron Luckstein, Acting Supervisor
Municipal Wastewater Section
Municipal Division

for The Minnesota Pollution Control Agency

Submit DMRs to:

Attention: Discharge Monitoring Reports
Minnesota Pollution Control Agency
520 Lafayette Rd N
St Paul, MN 55155-4194

Submit Other WQ Reports to:

Attention: WQ Submittals Center
Minnesota Pollution Control Agency
520 Lafayette Rd N
St Paul, MN 55155-4194

Questions on this permit?

- For DMR and other permit reporting issues, contact:
Tamara Dahl, 507-476-4252.
- For specific permit requirements or permit compliance status, contact:
Eric Pederson, 651-757-2645.
- General permit or NPDES program questions, contact:
MPCA, 651-282-6143 or 1-800-657-3938.

520 Lafayette Rd. N.; St. Paul, MN 55155-4194; 651-296-6300 (voice); 651-282-5332 (TTY)

Regional Offices: Duluth • Brainerd • Detroit Lakes • Marshall • Rochester

Equal Opportunity Employer • Printed on recycled paper containing at least 10% fibers from paper recycled by consumers

Table of Contents

Permitted Facility Description	3-4
Topographic Map of Permitted Facility	4
Facility Flow Diagram	5
Summary of Stations	6
Limits and Monitoring Requirements	7-9
Chapter 1. Waste Stream Stations	10
1. Requirements for Specific Stations	
2. Sampling Location	
Chapter 2. Surface Discharge Stations	10
1. Requirements for Specific Stations	
2. Special Requirements	
3. Sampling Location	
4. Surface Discharges	
5. Winter Sampling Conditions	
6. Discharge Monitoring Reports	
Chapter 3. Phosphorus Management Plan	11
1. General Requirements	
Chapter 4. Domestic Wastewater -- Mechanical System	11-13
1. Bypass Structures	
2. Sanitary Sewer Extension Permit	
3. Operator Certification	
4. Maintenance	
Chapter 5. Domestic Wastewater -- Septic Tanks	13
1. Septic Tank Maintenance	
Chapter 6. Domestic Wastewater -- Septage (analyzed)	13-17
1. Authorization	
2. Compliance Responsibility	
3. Notification Requirements	
4. Pollutant Limits	
5. Pathogen and Vector Attraction Reduction	
6. Management Practices	
7. Monitoring Requirements	
8. Records	
9. Reporting Requirements	
Chapter 7. Pretreatment	17-19
1. Pretreatment - Definitions	
2. Pretreatment - Permittee Responsibility to Control Users	
3. Control of Significant Industrial Users	
4. Monitoring of Significant Industrial Users	
5. Reporting and Notification	
Chapter 8. Total Facility Requirements	20-29
1. General Requirements	

Facility Description

The Nerstrand Wastewater Treatment Facility (Facility) is located at SW 1/4 of NE 1/4 of Section 14, Township 110 North, Range 19 West, Nerstrand, Rice County, Minnesota. This is a Class C Facility. Major components of the Facility include:

- Collection with gravity and/or Pressure Sewer
- 12 Septic Tanks
- 5 Recirculation Tanks
- 10 Recirculating Media Filters - sand/gravel
- Ultraviolet Light
- Heat Exchange Unit

The wastewater enters a divider well located at the Facility and is distributed to a bank of six (6) 16,000 gallon septic tanks followed by six (6) 5,000 gallon septic tanks. The flow then enters five (5) 5,000 gallon recirculation tanks in parallel and is mixed with recirculated sand filter effluent. The mixed wastewater then flows into a lift well and is pumped to each of the ten (10) recirculating sand filter cells, each measuring 25 feet by 100 feet. Each recirculating sand filter will receive a dose of wastewater for approximately 13 minutes every 75 minutes. The cells are constructed with an underdrain collection system from which flow will split back into the recirculating sand filters and the remaining portion is routed to an ultra-violet disinfection system. A heat exchange system is also provided to maintain the temperature of the wastewater. The disinfected effluent is discharged to an unnamed ditch, thence to the Little Cannon River.

The average wet weather flow for the Facility is 42,000 gallons per day (gpd), with a five-day carbonaceous biochemical oxygen demand (CBOD₅) strength of 270 milligrams per liter (mg/L) and an average dry weather flow of 35,000 gpd.

The Facility is further described in plans and specifications on file with the Minnesota Pollution Control Agency by the firms of Arden Environmental Engineering and TKDA. The location of designated monitoring stations is specified on the attached "Summary of Stations and Station Locations" report. The location of the Facility is shown on the attached topographical map.

The location of the Facility is shown on the "Topographical Map of Permitted Facility" (page 4).

The location of designated monitoring stations is specified on the "Summary of Stations" (page 6).


In accordance with MPCA rules regarding nondegradation for all waters that are not Outstanding Resource Value Waters, nondegradation review is required for any new or expanded significant discharge (Minn. R. 7050.0185). A significant discharge is 1) a new discharge (not in existence before January 1, 1988) that is greater than 200,000 gallons per day to any water other than a Class 7 water or 2) an expanded discharge that expands by greater than 200,000 gallons per day that discharges to any water other than a Class 7 water or 3) a new or expanded discharge containing any toxic pollutant at a mass loading rate likely to increase the concentration of the toxicant in the receiving water by greater than one percent over the baseline quality. The flow rate used to determine significance is the design average wet weather flow. The January 1, 1988, design average wet weather flow for this facility is 0 mgd.

This Permit also complies with Minn. R. 7053.0275 regarding anti-backsliding.

Any point source discharger of sewage, industrial, or other wastes for which a NPDES permit has been issued by the MPCA that contains effluent limits more stringent than those that would be established by parts 7053.0215 to 7053.0265 shall continue to meet the effluent limits established by the permit, unless the Permittee establishes that less stringent effluent limits are allowable pursuant to federal law, under section 402(o) of the Clean Water Act, United States Code, title 33, section 1342.

Topographic Map of Permitted Facility

MN0065668: Nerstrand Wastewater Treatment Facility
T110N, R19W, Section 14
Nerstrand, Rice County, Minnesota

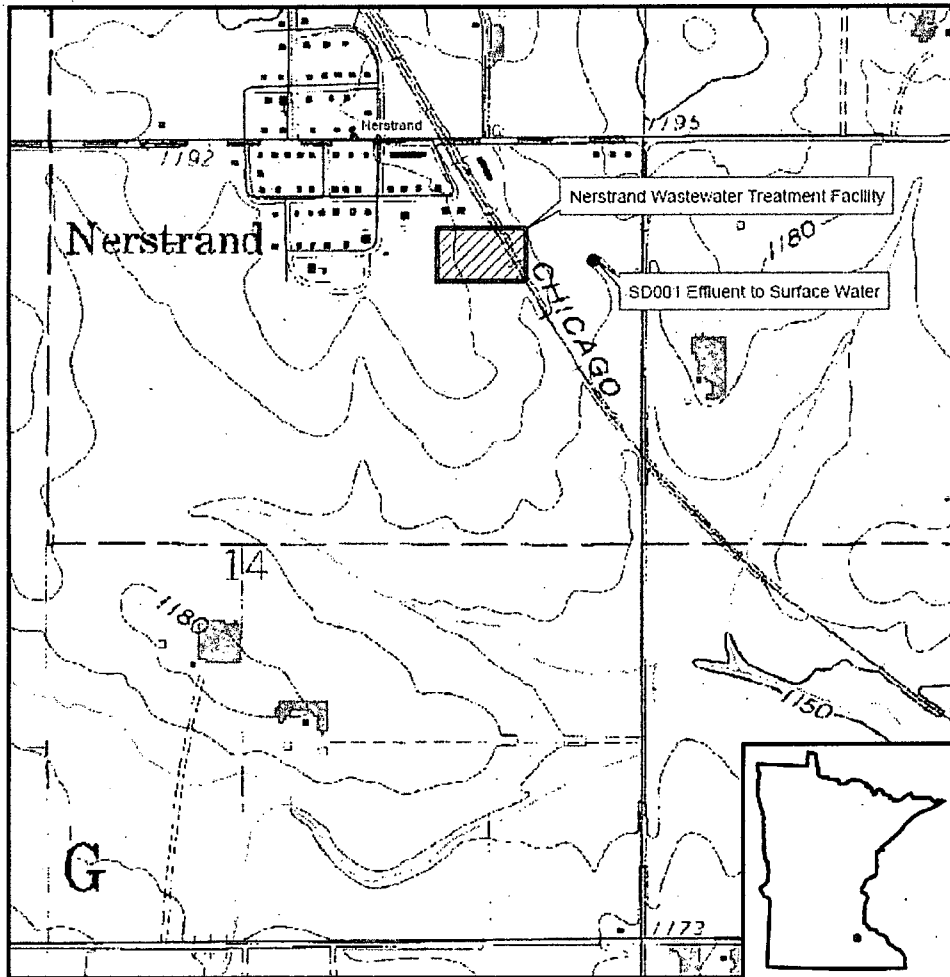


Map produced by: MPCA Staff, 1/25/2012
Source: USGS Quad
Scale: 1:10,000

0 0.05 0.1 0.2 Miles



Facility Flow Diagram

DESIGN PARAMETERS:
 DESIGN FLOW = 42,000 GPD
 DESIGN BOD = 200 mg/l DESIGN TSS = 3 DAYS
 FILTER CELL ORGANIC LOADING RATE = 0.0015 LBOD/FT²
 FILTER CELL HYDRAULIC LOADING RATE = 1.00 GPD/FT²

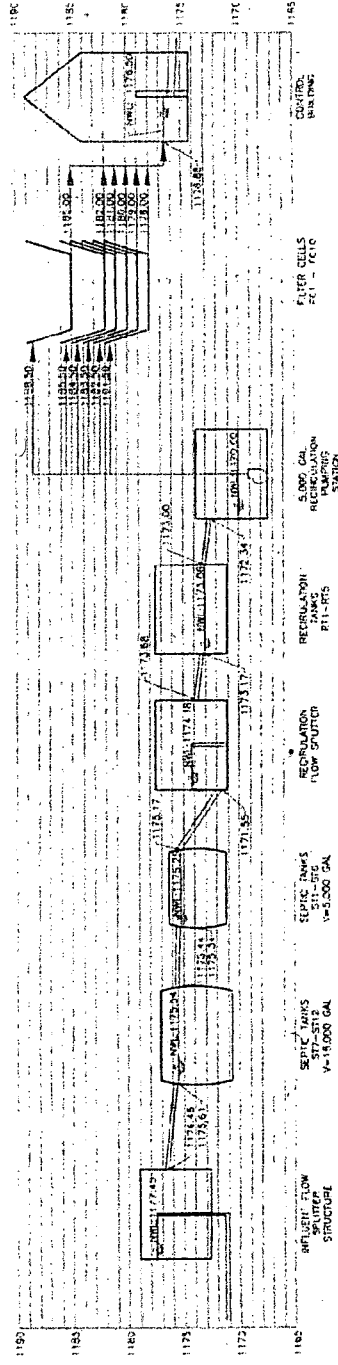

Nerstrand WWTP Summary of Stations

Surface Discharge Stations

<u>Station</u>	<u>Type of Station</u>	<u>Local Name</u>	<u>PLS Location</u>
SD001	Effluent To Surface Water	Effluent	NE Quarter of the NW Quarter of Section 13, Township 110 North, Range 19 West

Waste Stream Stations

<u>Station</u>	<u>Type of Station</u>	<u>Local Name</u>	<u>PLS Location</u>
WS001	Influent Waste	Influent	NE Quarter of the NW Quarter of Section 14, Township 110 North, Range 19 West
WS002	Internal Waste Stream	Septic Tank 1 (5000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS003	Internal Waste Stream	Septic Tank 2 (5000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS004	Internal Waste Stream	Septic Tank 3 (5000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS005	Internal Waste Stream	Septic Tank 4 (5000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS006	Internal Waste Stream	Septic Tank 5 (5000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS007	Internal Waste Stream	Recirculation Tank 1	NE Quarter of Section 14, Township 110 North, Range 19 West
WS008	Internal Waste Stream	Recirculation Tank 2	NE Quarter of Section 14, Township 110 North, Range 19 West
WS009	Internal Waste Stream	Recirculation Tank 3	NE Quarter of Section 14, Township 110 North, Range 19 West
WS010	Internal Waste Stream	Recirculation Tank 4	NE Quarter of Section 14, Township 110 North, Range 19 West
WS011	Internal Waste Stream	Recirculation Tank 5	NE Quarter of Section 14, Township 110 North, Range 19 West
WS017	Internal Waste Stream	Septic Tank 6 (5000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS018	Internal Waste Stream	Septic Tank 7 (16,000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS019	Internal Waste Stream	Septic Tank 8 (16,000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS020	Internal Waste Stream	Septic Tank 9 (16,000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS021	Internal Waste Stream	Septic Tank 10 (16,000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS022	Internal Waste Stream	Septic Tank 11 (16,000 gal)	NE Quarter of Section 14, Township 110 North, Range 19 West
WS023	Internal Waste Stream	Septic Tank 12 (16,000 gal)	NE Quarter of Section 14, Township 110 North, Range 14 West

Nerstrand WWTP Limits and Monitoring Requirements

The Permittee shall comply with the limits and monitoring requirements as specified below.

SD 001

Parameter	Limit	Units	Limit Type	Effective Period	Sample Type	Frequency	Notes
Bicarbonates	Monitor Only	mg/L	Calendar Quarter Maximum	Jan-Dec	24-Hour Flow Composite	1 x Quarter	
BOD, Carbonaceous 05 Day (20 Deg C)	0.79	kg/day	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
BOD, Carbonaceous 05 Day (20 Deg C)	5	mg/L	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
BOD, Carbonaceous 05 Day (20 Deg C)	1.19	kg/day	Maximum Calendar Week Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
BOD, Carbonaceous 05 Day (20 Deg C)	7.5	mg/L	Maximum Calendar Week Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
BOD, Carbonaceous 05 Day (20 Deg C) Percent Removal	85	%	Minimum Calendar Month Average	Jan-Dec	Calculation	2 x Month	
Calcium, Total (as Ca)	Monitor Only	mg/L	Calendar Quarter Maximum	Jan-Dec	24-Hour Flow Composite	1 x Quarter	
Chloride, Total	Monitor Only	mg/L	Calendar Quarter Maximum	Jan-Dec	24-Hour Flow Composite	1 x Quarter	
Fecal Coliform, MPN or Membrane Filter 44.5C	200	#100ml	Calendar Month Geometric Mean	Apr-Oct	Grab	2 x Month	
Flow	Monitor Only	mgd	Calendar Month Average	Jan-Dec	Measurement, Continuous	1 x Day	2
Flow	Monitor Only	mgd	Calendar Month Maximum	Jan-Dec	Measurement, Continuous	1 x Day	2
Flow	Monitor Only	MG	Calendar Month Total	Jan-Dec	Measurement, Continuous	1 x Day	2
Hardness, Calcium & Magnesium, Calculated (as CaCO3)	Monitor Only	mg/L	Calendar Quarter Maximum	Jan-Dec	24-Hour Flow Composite	1 x Quarter	
Magnesium, Total (as Mg)	Monitor Only	mg/L	Calendar Quarter Maximum	Jan-Dec	24-Hour Flow Composite	1 x Quarter	
Nitrogen, Ammonia, Total (as N)	0.78	kg/day	Calendar Month Average	Dec-Mar	24-Hour Flow Composite	2 x Month	
Nitrogen, Ammonia, Total (as N)	4.9	mg/L	Calendar Month Average	Dec-Mar	24-Hour Flow Composite	2 x Month	
Nitrogen, Ammonia, Total (as N)	0.25	kg/day	Calendar Month Average	Apr-May	24-Hour Flow Composite	2 x Month	
Nitrogen, Ammonia, Total (as N)	1.6	mg/L	Calendar Month Average	Apr-May	24-Hour Flow Composite	2 x Month	
Nitrogen, Ammonia, Total (as N)	0.16	kg/day	Calendar Month Average	Jun-Sep	24-Hour Flow Composite	2 x Month	
Nitrogen, Ammonia, Total (as N)	1.0	mg/L	Calendar Month Average	Jun-Sep	24-Hour Flow Composite	2 x Month	
Nitrogen, Ammonia, Total (as N)	0.38	kg/day	Calendar Month Average	Oct-Nov	24-Hour Flow Composite	2 x Month	
Nitrogen, Ammonia, Total (as N)	2.4	mg/L	Calendar Month Average	Oct-Nov	24-Hour Flow Composite	2 x Month	
Nitrogen, Nitrate, Total (as N)	Monitor Only	mg/L	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	1 x Month	
Oxygen, Dissolved	Monitor Only	mg/L	Calendar Month Minimum	Jan-Dec	Grab	2 x Month	1
pH	9.0	SU	Calendar Month Maximum	Jan-Dec	Grab	2 x Month	1
pH	6.0	SU	Calendar Month Minimum	Jan-Dec	Grab	2 x Month	1
Phosphorus, Total (as P)	Monitor Only	kg/day	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
Phosphorus, Total (as P)	Monitor Only	mg/L	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	2 x Month	

Nerstrand WWTP
Limits and Monitoring Requirements

The Permittee shall comply with the limits and monitoring requirements as specified below.

SD 001

Parameter	Limit	Units	Limit Type	Effective Period	Sample Type	Frequency	Notes
Potassium, Total (as K)	Monitor Only	mg/L	Calendar Quarter Maximum	Jan-Dec	24-Hour Flow Composite	1 x Quarter	
Sodium, Total (as Na)	Monitor Only	mg/L	Calendar Quarter Maximum	Jan-Dec	24-Hour Flow Composite	1 x Quarter	
Solids, Total Dissolved (TDS)	Monitor Only	mg/L	Calendar Quarter Maximum	Jan-Dec	24-Hour Flow Composite	1 x Quarter	
Solids, Total Suspended (TSS)	4.76	kg/day	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
Solids, Total Suspended (TSS)	30	mg/L	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
Solids, Total Suspended (TSS)	7.15	kg/day	Maximum Calendar Week Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
Solids, Total Suspended (TSS)	45	mg/L	Maximum Calendar Week Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
Solids, Total Suspended (TSS) Percent Removal	85	%	Minimum Calendar Month Average	Jan-Dec	Calculation	2 x Month	
Specific Conductance	Monitor Only	umh/cm	Calendar Quarter Maximum	Jan-Dec	Measurement	1 x Quarter	
Sulfate, Total (as SO4)	Monitor Only	mg/L	Calendar Quarter Maximum	Jan-Dec	24-Hour Flow Composite	1 x Quarter	

WS 001

Parameter	Limit	Units	Limit Type	Effective Period	Sample Type	Frequency	Notes
BOD, Carbonaceous 05 Day (20 Deg C)	Monitor Only	mg/L	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
BOD, Carbonaceous 05 Day (20 Deg C)	Monitor Only	mg/L	Calendar Month Maximum	Jan-Dec	24-Hour Flow Composite	2 x Month	
pH	Monitor Only	SU	Calendar Month Maximum	Jan-Dec	Grab	2 x Month	1
pH	Monitor Only	SU	Calendar Month Minimum	Jan-Dec	Grab	2 x Month	1
Phosphorus, Total (as P)	Monitor Only	mg/L	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
Precipitation	Monitor Only	in	Calendar Month Total	Jan-Dec	Measurement	1 x Day	
Solids, Total Suspended (TSS)	Monitor Only	mg/L	Calendar Month Average	Jan-Dec	24-Hour Flow Composite	2 x Month	
Solids, Total Suspended (TSS)	Monitor Only	mg/L	Calendar Month Maximum	Jan-Dec	24-Hour Flow Composite	2 x Month	

WS 002, WS 003, WS 004, WS 005, WS 006, WS 007, WS 008, WS 009, WS 010, WS 011, WS 017, WS 018, WS 019, WS 020, WS 021, WS 022, WS 023

Parameter	Limit	Units	Limit Type	Effective Period	Sample Type	Frequency	Notes
Remaining Scum Capacity	Monitor Only	in	Calendar Month Maximum	Jan-Dec	Measurement	1 x Month	
Remaining Sludge Capacity	Monitor Only	in	Calendar Month Maximum	Jan-Dec	Measurement	1 x Month	
Scum Depth, Maximum of Sample	Monitor Only	in	Calendar Month Maximum	Jan-Dec	Measurement	1 x Month	
Sludge Depth, Maximum of Sample	Monitor Only	in	Calendar Month Maximum	Jan-Dec	Measurement	1 x Month	

Nerstrand WWTP
Limits and Monitoring Requirements

The Permittee shall comply with the limits and monitoring requirements as specified below.

Notes:

1 -- Analyze immediately.

2 -- Influent flow measurements are to be reported on the SD001 DMR. You do not need to install effluent flow meters.

Chapter 1. Waste Stream Stations

1. Requirements for Specific Stations

- 1.1 WS 001, WS 002, WS 003, WS 004, WS 005, WS 006, WS 007, WS 008, WS 009, WS 010, WS 011, WS 017, WS 018, WS 019, WS 020, WS 021, WS 022, WS 023: Submit a monthly DMR by 21 days after the end of each calendar month following permit issuance.

2. Sampling Location

- 2.1 Grab and composite samples for Station WS001 shall be collected at a point representative of total influent flow to the system.
- 2.2 Measurements for Stations WS002-011 and WS017-023 shall be taken at a point representative of the septic tanks at the treatment facility.

Chapter 2. Surface Discharge Stations

1. Requirements for Specific Stations

- 1.1 SD 001: Submit a monthly DMR monthly by 21 days after the end of each calendar month following permit issuance.

2. Special Requirements

Salty Discharge Monitoring Requirements

- 2.1 Industrial and municipal facilities that have a stream to effluent dilution ratio of less than 5:1 or that have salty waste streams from concentrated treatment technologies (e.g. reverse osmosis, ion exchange, membrane filtration, cooling tower blowdown, etc.) or that have food processing industries using density based (saline) sorting processes are required to complete the analyses for the following salty discharge parameters: chloride, calcium and magnesium hardness as CaCO₃, specific conductance, total dissolved salts (solids), sulfates as SO₄, bicarbonates (HCO₃), sodium, calcium, magnesium, and potassium. These analyses are required to be sampled quarterly from the effluent waste stream.
- 2.2 If salty discharge monitoring results indicate a reasonable potential for any of the parameters to exceed water quality standards, the Permittee will be required to submit an application for permit modification. If necessary, a compliance schedule will be added to the permit to ensure progress towards meeting the water quality standards.
- 2.3 The Permittee may request a reduction in monitoring for the salty discharge parameters if after a minimum of two years of data collection the monitoring data does not indicate a reasonable potential to exceed a water quality standard.

3. Sampling Location

- 3.1 Samples for Station SD001 shall be taken at a point representative of the discharge.

4. Surface Discharges

- 4.1 Floating solids or visible foam shall not be discharged in other than trace amounts.
- 4.2 Oil or other substances shall not be discharged in amounts that create a visible color film.
- 4.3 The Permittee shall install and maintain outlet protection measures at the discharge stations to prevent erosion.

5. Discharge Monitoring Reports

- 5.1 The Permittee shall submit monitoring results for discharges in accordance with the limits and monitoring requirements for this station. If no discharge occurred during the reporting period, the Permittee shall check the "No Discharge" box on the Discharge Monitoring Report (DMR).

Chapter 3. Phosphorus Management Plan

1. General Requirements

- 1.1 Phosphorus is a common constituent in many wastewater discharges and a pollutant that has the potential to negatively impact the quality of Minnesota's lakes, wetlands, rivers and streams. Therefore, phosphorus discharges are being carefully evaluated throughout the state.

The Permittee is required to complete and submit a Phosphorus Management Plan (PMP) to the MPCA as detailed in this section. If the Permittee has already submitted a PMP, the Permittee must update that PMP and submit the updated PMP to the MPCA as detailed in this section.

While the PMP does not require specific reductions at this time, the MPCA strongly encourages the Permittee to identify and eliminate/reduce sources of phosphorus to, and improve phosphorus management within, the permitted wastewater treatment facility. However, be aware that new or expanding discharges may be required to actively manage and reduce phosphorus, including complying with new or tighter phosphorus effluent limits.

For additional information about completing the PMP below, please contact the MPCA at 651-282-6143 or 800-657-3864.

- 1.2 The Permittee shall submit a Phosphorus Management Plan (PMP) or an updated PMP to the MPCA 180 days prior to permit expiration.

At a minimum, the PMP shall include the following:

- a. A summary of influent and effluent concentrations, mass loadings, and percent removal calculations using the most recent five years of monitoring data, if available.
- b. Identification of existing and potential sources of elevated phosphorus concentrations and/or loading to the facility. As appropriate for the facility, consider residential, institutional, municipal, and commercial sources.
- c. An evaluation of past and present WWTF operations to determine those operating procedures that maximize phosphorus removal.
- d. A summary of any phosphorus reduction activities implemented during the last five years.
- e. Phosphorus management and reduction goals for the next five years using the information collected in A through D above.
- f. A plan to implement phosphorus management and reduction measures during the next five years.

Chapter 4. Domestic Wastewater -- Mechanical System

1. Bypass Structures

- 1.1 All structures capable of bypassing the treatment system shall be manually controlled and kept locked at all times.

2. Sanitary Sewer Extension Permit

- 2.1 The Permittee may be required to obtain a Sanitary Sewer Extension Permit from the MPCA for any addition, extension or replacement to the sanitary sewer. If a sewer extension permit is required, construction may not begin until plans and specifications have been submitted and a written permit is granted except as allowed in Minn. Stat. 115.07, Subd. 3(b).

Chapter 4. Domestic Wastewater -- Mechanical System

3. Operator Certification

- 3.1 The Permittee shall provide a Class C state certified operator who is in direct responsible charge of the operation, maintenance and testing functions required to ensure compliance with the terms and conditions of this permit.
- 3.2 The Permittee shall provide the appropriate number of operators with a Type IV certification to be responsible for the land application of biosolids or semisolids from commercial or industrial operations.
- 3.3 If the Permittee chooses to meet operator certification requirements through a contractual agreement, the Permittee shall provide a copy of the contract to the MPCA, WQ Submittals Center. The contract shall include the certified operator's name, certificate number, company name if appropriate, the period covered by the contract and provisions for renewal; the duties and responsibilities of the certified operator; the duties and responsibilities of the permittee; and provisions for notifying the MPCA 30 days in advance of termination if the contract is terminated prior to the expiration date.
- 3.4 The Permittee shall notify the MPCA within 30 days of a change in operator certification or contract status.

4. Maintenance

Operation and Maintenance Manual

Chapter 4. Domestic Wastewater -- Mechanical System

4. Maintenance

- 4.1 The Permittee is required to have on-site and available an updated Operation and Maintenance manual. This manual must be available to MPCA staff upon request.

Collection System Maintenance

- 4.2 The collection system shall be properly maintained to minimize inflow, infiltration, exfiltration, and obstructions. A record of all inspections and maintenance operations shall be kept by the Permittee for a minimum of three years.

Chapter 5. Domestic Wastewater -- Septic Tanks

1. Septic Tank Maintenance

- 1.1 All tanks (primary, secondary, holding, dosing, individual, etc) associated with this system shall be operated, pumped and maintained to ensure proper system operation and solids management. After every pumping event, all tanks shall be inspected for potential failure (such as cracks, roots, damaged baffles, etc.). Identified problems shall be corrected immediately.
- 1.2 The owner of a septic tank or tanks or the owner's agent must arrange for the removal and proper disposal of septage from all tanks or compartments in which the top of the sludge layer is less than 12 inches below the bottom of the outlet baffle or whenever the bottom of the scum layer is less than three inches above the outlet baffle. All accumulations of sludge, scum, and liquids must be removed through the maintenance hole.
- 1.3 The Permittee shall properly clean the effluent screens as often as needed to maintain an adequate flow rate from the septic tank(s). The Permittee shall keep a record at the facility that indicates the dates that the effluent screens are inspected, removed and cleaned.
- 1.4 Tanks that are not specifically covered under the Limits & Monitoring section of this permit shall be inspected at least every three years and pumped as necessary unless more restrictive local requirements have been established.

Chapter 6. Domestic Wastewater -- Septage (analyzed)

1. Authorization

- 1.1 This permit authorizes the Permittee to store and land apply domestic wastewater treatment septage that is defined as biosolids in accordance with the provision in this chapter and Minnesota Rules, ch. 7041. For the purpose of this permit chapter, septage is also referred to as biosolids.
- 1.2 Permittees who prepare bulk biosolids must obtain approval of the sites on which bulk biosolids are applied before they are applied unless they are exceptional quality biosolids. Site application procedures are set forth in Minnesota Rules, pt. 7041.0800.

2. Compliance Responsibility

- 2.1 The Permittee is responsible for ensuring that the applicable requirements in this chapter and Minnesota Rules ch. 7041 are met when biosolids are prepared, distributed, or applied to the land.

3. Notification Requirements

- 3.1 The Permittee shall provide information needed to comply with the biosolids requirements of Minnesota Rules, ch. 7041 to others who prepare or use the biosolids.

Chapter 6. Domestic Wastewater -- Septage (analyzed)

4. Pollutant Limits

- 4.1 Biosolids which are applied to the land must not exceed the ceiling concentrations in Table 1 and must not be applied so that the cumulative amounts of pollutant in Table 2 are exceeded.

Table 1 Ceiling Concentrations (dry weight basis)

Parameter in units mg/kg

Arsenic 75
Cadmium 85
Copper 4300
Lead 840
Mercury 57
Molybdenum 75
Nickel 420
Selenium 100
Zinc 7500

Table 2 Cumulative Loading Limits

Parameter in units lbs/acre

Arsenic 37
Cadmium 35
Copper 1339
Lead 268
Mercury 15
Molybdenum not established*
Nickel 375
Selenium 89
Zinc 2500

*The cumulative limit for molybdenum has not been established at the time of permit issuance

5. Pathogen and Vector Attraction Reduction

- 5.1 Biosolids shall be processed, treated, or be incorporated or injected into the soil to meet pathogen and vector attraction reduction requirements in Minnesota Rules, part 7041.1800, subp. 3, items a, b, or c as follows:
- the pH of the septage must be raised to 12 or higher for 30 minutes by alkali addition and, without the addition of more alkali, shall remain at 12 or higher for 30 minutes;
 - the septage is injected and no significant amount of the septage is present on the land surface within one hour after it is injected, or
 - the septage is incorporated below the surface of the land within six hours after surface application.

Chapter 6. Domestic Wastewater -- Septage (analyzed)

5. Pathogen and Vector Attraction Reduction

- 5.2 The minimum duration between application and harvest, grazing or public access to areas where biosolids have been applied to the land is as follows:
- a. 14 months for food crops whose harvested parts may touch the soil/biosolids mixture (such as melons, squash, tomatoes, etc.), when biosolids are surface applied, incorporated or injected.
 - b. 20 months or 38 months depending on the application method for food crops whose harvested parts grow in the soil (such as potatoes, carrots, onions, etc.). The 20 month time period is required when biosolids are surface applied or surface applied and incorporated after they have been on the soil surface for at least four (4) months. The 38 month time period is required when the biosolids are injected or surface applied and incorporated within four (4) months of application.
 - c. 30 days for feed crops, other food crops (such as field corn, sweet corn, etc.), hay or fiber crops when biosolids are surface applied, incorporated or injected.
 - d. 30 days for grazing of animals when biosolids are surface applied, incorporated or injected.
 - e. One year where there is a high potential for public contact with the site, (such as a reclamation site located in populated areas, a construction site located in a city, turf farms, plant nurseries, etc.) and 30 days where there is low potential for public contact (such as agricultural land, forest, a reclamation site located in an unpopulated area, etc.) when biosolids are surface applied, incorporated, or injected.

6. Management Practices

- 6.1 The management practices for the land application of biosolids are described in detail in Minnesota Rules, pt. 7041.1200 and must be followed unless specified otherwise in a site approval letter or a permit issued by the MPCA.
- 6.2 Overall management requirements:
- a. Biosolids must not be applied to the land if it is likely to adversely affect a threatened or endangered species listed under Section 4 of the Endangered Species Act or its designated critical habitat.
 - b. Biosolids must not be applied to flooded, frozen or snow covered ground so that the biosolids enter wetlands or other waters of the state.
 - c. Biosolids must be applied at an agronomic rate unless specified otherwise by the MPCA in a permit.
 - d. Biosolids shall not be applied within 33 feet of a wetland or waters of the state unless specified otherwise by the MPCA in a permit.

7. Monitoring Requirements

- 7.1 Representative samples of biosolids applied to the land must be analyzed by methods specified in Minnesota Rule pt. 7041.3200 for the following parameters: arsenic, cadmium, copper, lead, mercury, molybdenum, nickel, selenium, zinc, Kjeldahl nitrogen, ammonia nitrogen, total solids, volatile solids, phosphorus, potassium and pH.
- 7.2 Biosolids must be monitored at a minimum frequency of once per cropping year when biosolids are land applied for the parameters listed above, and any pathogen or vector attraction reduction requirements in Minnesota Rules, part 7041.1800 if used to determine compliance with those parts.

Chapter 6. Domestic Wastewater -- Septage (analyzed)

7. Monitoring Requirements

7.3 Increased sampling frequencies are specified for the parameters listed in Table 4. Sampling at a frequency at twice the minimum frequencies in Table 3 is required if concentrations listed in Table 4 are exceeded (based on the average of all analyses made during the previous cropping year).

- Table 4 Increased Frequency of Sampling

Parameter (mg/kg dry weight basis)

Arsenic 38

Cadmium 43

Copper 2150

Lead 420

Mercury 28

Molybdenum 38

Nickel 210

Selenium 50

Zinc 3750

8. Records

8.1 The Permittee must obtain, and keep on record for five years, the information required to be in compliance with this chapter and Minnesota Rules part 7041.1800, subp. 4 including:

- a. The following certification statement for all septage applied to the land:

"I certify, under penalty of law, that the information that will be used to determine compliance with the pathogen and vector attraction reduction requirements in part 7041.1800, subp. 3 ____, item A, B, or C [insert either item A, B, or C] the management practices in part 7041.1200, and the site restrictions in part 7041.1300, subpart 3, item D, has been prepared under my direction and supervision according to the system designed to ensure that qualified personnel properly gather and evaluate the information used to determine that the pathogen and vector attraction reduction requirements have been met. I am aware that there are significant penalties for false certification including the possibility of fine and imprisonment.";

- b. a description of how the pathogen and vector attraction reduction requirements are met. If alkali addition is used, records must indicate each container of septage applied is monitored for compliance with subpart 3, item A;

- c. a description of how management practices and site restrictions are met;

- d. a record of soil test data as required by part 7041.0800, site approvals, or permits;

- e. the maximum available nitrogen application rate based on the realistic yield goal of the crop or vegetation grown on the site during the cropping year;

- f. the amount of septage in gallons per acre applied that cropping year;

- g. the legal description of the land application site;

- h. the number of acres used;

- i. the date septage is applied to the land; and

- j. any other analysis or information required by the MPCA.

Chapter 6. Domestic Wastewater -- Septage (analyzed)

9. Reporting Requirements

- 9.1 By December 31 following the end of each cropping year, the Permittee shall submit a Biosolids Annual Report for the land application of biosolids on a form provided by or approved by the MPCA. The report shall include the requirements in Minnesota Rules, part 7041.1800, subp. 4.
- 9.2 If, during any cropping year, biosolids were transferred, or not land applied, the Permittee shall submit a Biosolids Annual Report by December 31 following the end of the cropping year. The report shall state that biosolids were not land applied, how much was generated, and where they were transferred to.
- 9.3 The Permittee shall submit the Biosolids Annual Report to:

Biosolids Coordinator
Minnesota Pollution Control Agency
520 Lafayette Road North
St. Paul, Minnesota 55155-4194
- 9.4 The Permittee must notify the MPCA in writing when 90 percent or more of any of the cumulative pollutant loading rates listed for any Land Application Sites has been reached for a site.

Chapter 7. Pretreatment

1. Pretreatment - Definitions

- 1.1 An "Individual Control Mechanism" is a document, such as an agreement or permit, that imposes limitations or requirements on an individual industrial user of the POTW.
- 1.2 "Significant Industrial User" (SIU) means any industrial user that:
 - a. discharges 25,000 gallons per day or more of process wastewater;
 - b. contributes a load of five (5) % or more of the capacity of the POTW; or
 - c. is designated as significant by the Permittee or the MPCA on the basis that the SIU has a reasonable potential to adversely impact the POTW, or the quality of its effluent or residuals. (Minn. R. 7049.0120, Subp. 24)

2. Pretreatment - Permittee Responsibility to Control Users

- 2.1 It is the Permittee's responsibility to regulate the discharge from users of its wastewater treatment facility. The Permittee shall prevent any pass through of pollutants or any inhibition or disruption of the Permittee's facility, its treatment processes, or its sludge processes or disposal that contribute to the violation of the conditions of this permit or any federal or state law or regulation limiting the release of pollutants from the POTW. (Minn. R. 7049.0600)

Chapter 7. Pretreatment

2. Pretreatment - Permittee Responsibility to Control Users

2.2 The Permittee shall prohibit the discharge of the following to its wastewater treatment facility:

- a. pollutants which create a fire or explosion hazard, including any discharge with a flash point less than 60 degrees C (140 degrees F);
- b. pollutants which would cause corrosive structural damage to the POTW, including any waste stream with a pH of less than 5.0;
- c. solid or viscous pollutants which would obstruct flow;
- d. heat that would inhibit biological activity, including any discharge that would cause the temperature of the waste stream at the POTW treatment plant headworks to exceed 40 degrees C (104 degrees F);
- e. pollutants which produce toxic gases, vapors, or fumes that may endanger the health or safety of workers; or
- f. any pollutant, including oxygen demanding pollutants such as biochemical oxygen demand, released at a flow rate or pollutant concentration that will cause interference or pass through. (Minn. R. 7049.0140)

2.3 The Permittee shall prohibit new discharges of non-contact cooling waters unless there is no cost effective alternative. Existing discharges of non-contact cooling water to the Permittee's wastewater treatment facility shall be eliminated, where elimination is cost-effective, or where an infiltration/inflow analysis and sewer system evaluation survey indicates the need for such removal.

2.4 If the Permittee accepts trucked-in wastes, the Permittee shall evaluate the trucked in wastes prior to acceptance in the same manner as it monitors sewered wastes. The Permittee shall accept trucked-in wastes only at specifically designated points. (Minn. R. 7049.0140, Subp. 4)

2.5 Pollutant of concern means a pollutant that is or may be discharged by an industrial user that is, or reasonably should be of concern on the basis that it may cause the permittee to violate any permit limits on the release of pollutants. The following pollutants shall be evaluated to determine if they should be pollutants of concern: pollutants limited in this permit, pollutants for which monitoring is required in this permit, pollutants that are likely to cause inhibition of the Permittee's POTW, pollutants which may interfere with sludge disposal, and pollutants for which the Permittee's treatment facility has limited capacity. (Minn. R. 7049.0120, Subp. 13)

3. Control of Significant Industrial Users

3.1 The Permittee shall impose pretreatment requirements on SIUs which will ensure compliance with all applicable effluent limitations and other requirements set forth in this permit or any federal or state law or regulation limiting the release of pollutants from the POTW. These requirements shall be applied to SIUs by means of an individual control mechanism. (Minn. R. 7049.0600)

3.2 The Permittee shall not knowingly enter into an individual control mechanism with any user that would allow the user to contribute an amount or strength of wastewater that would cause violation of any limitation or requirement in the permit, or any applicable federal, state or local law or regulation. (Minn. R. 7049.0600 Subp. 3)

4. Monitoring of Significant Industrial Users

4.1 The Permittee shall obtain from SIUs specific information on the quality and quantity of the SIU's discharges to the Permittee's POTW. Except where specifically requested by the Permittee and approved by the MPCA, this information shall be obtained by means of representative monitoring conducted by the Permittee or by the SIU under requirements imposed by the Permittee in the SIU's individual control mechanism. Monitoring performed to comply with this requirement shall include all pollutants for which the SIU is significant and shall be done at a frequency commensurate with the significance of the SIU. (Minn. R. 7049.0710)

Chapter 7. Pretreatment

5. Reporting and Notification

5.1 If a SIU discharges to the POTW during a given calendar year, the Permittee shall submit a Pretreatment Annual Report for that calendar year, due by January 31 of the following year. The Pretreatment Annual Report shall be submitted on forms provided by the agency or shall provide equivalent information.

The Permittee shall submit the pre-treatment report to the following address:

MPCA
Attn: WQ Submittals Center
520 Lafayette Road North
St. Paul, Minnesota 55155-4194 (Minn. R. 7049.0720)

5.2 The Permittee shall notify the MPCA in writing of any:

- a. SIU of the Permittee's POTW which has not been previously disclosed to the MPCA;
- b. anticipated or actual changes in the volume or quality of discharge by an industrial user that could result in the industrial user becoming an SIU as defined in this chapter; or
- c. anticipated or actual changes in the volume or quality of discharges by a SIU that would require changes to the SIU's required local limits.

This notification shall be submitted within 30 days of identifying the IU as a SIU. Where changes are proposed, they must be submitted prior to changes being made. (Minn. R. 7049.0700, Subp. 1)

5.3 Upon notifying the MPCA of a SIU or change in a SIU discharge as required above, the Permittee shall submit the following information on forms provided by the agency or in a comparable format:

- a. the identity of the SIU and a description of the SIU's operation and process;
- b. a characterization of the SIU's discharge;
- c. the required local limits that will be imposed on the SIU;
- d. a technical justification of the required local limits; and
- e. a plan for monitoring the SIU which is consistent with monitoring requirements in this chapter. (Minn. R. 7049.0700)

5.4 In addition, the Permittee shall, upon request, submit the following to the MPCA for approval:

- a. additional information on the SIU, its processes and discharge;
- b. a copy of the individual control mechanism used to control the SIU;
- c. the Permittee's legal authority to be used for regulating the SIU; and
- d. the Permittee's procedures for enforcing the requirements imposed on the SIU. (Minn. R. 7049.0700, Subp. 3)

5.5 The permittee shall notify MPCA of any of its industrial users that may be subject to national categorical pretreatment standards.

5.6 This permit may be modified in accordance with Minnesota Rules, ch. 7001 to require development of a pretreatment program approvable under the Federal General Pretreatment Regulation (40 CFR 403).

Chapter 8. Total Facility Requirements

1. General Requirements

General Requirements

- 1.1 Incorporation by Reference. The following applicable federal and state laws are incorporated by reference in this permit, are applicable to the Permittee, and are enforceable parts of this permit: 40 CFR pts. 122.41, 122.42, 136, 403 and 503; Minn. R. pts. 7001, 7041, 7045, 7050, 7052, 7053, 7060, and 7080; and Minn. Stat. Sec. 115 and 116.
- 1.2 Permittee Responsibility. The Permittee shall perform the actions or conduct the activity authorized by the permit in compliance with the conditions of the permit and, if required, in accordance with the plans and specifications approved by the Agency. (Minn. R. 7001.0150, subp. 3, item E)
- 1.3 Toxic Discharges Prohibited. Whether or not this permit includes effluent limitations for toxic pollutants, the Permittee shall not discharge a toxic pollutant except according to Code of Federal Regulations, Title 40, sections 400 to 460 and Minnesota Rules 7050, 7052, 7053 and any other applicable MPCA rules. (Minn. R. 7001.1090, subp.1, item A)
- 1.4 Nuisance Conditions Prohibited. The Permittee's discharge shall not cause any nuisance conditions including, but not limited to: floating solids, scum and visible oil film, acutely toxic conditions to aquatic life, or other adverse impact on the receiving water. (Minn. R. 7050.0210 subp. 2)
- 1.5 Property Rights. This permit does not convey a property right or an exclusive privilege. (Minn. R. 7001.0150, subp. 3, item C)
- 1.6 Liability Exemption. In issuing this permit, the state and the MPCA assume no responsibility for damage to persons, property, or the environment caused by the activities of the Permittee in the conduct of its actions, including those activities authorized, directed, or undertaken under this permit. To the extent the state and the MPCA may be liable for the activities of its employees, that liability is explicitly limited to that provided in the Tort Claims Act. (Minn. R. 7001.0150, subp. 3, item O)
- 1.7 The MPCA's issuance of this permit does not obligate the MPCA to enforce local laws, rules, or plans beyond what is authorized by Minnesota Statutes. (Minn. R. 7001.0150, subp.3, item D)
- 1.8 Liabilities. The MPCA's issuance of this permit does not release the Permittee from any liability, penalty or duty imposed by Minnesota or federal statutes or rules or local ordinances, except the obligation to obtain the permit. (Minn. R. 7001.0150, subp.3, item A)
- 1.9 The issuance of this permit does not prevent the future adoption by the MPCA of pollution control rules, standards, or orders more stringent than those now in existence and does not prevent the enforcement of these rules, standards, or orders against the Permittee. (Minn. R. 7001.0150, subp.3, item B)
- 1.10 Severability. The provisions of this permit are severable and, if any provisions of this permit or the application of any provision of this permit to any circumstance are held invalid, the application of such provision to other circumstances and the remainder of this permit shall not be affected thereby.
- 1.11 Compliance with Other Rules and Statutes. The Permittee shall comply with all applicable air quality, solid waste, and hazardous waste statutes and rules in the operation and maintenance of the facility.
- 1.12 Inspection and Entry. When authorized by Minn. Stat. Sec. 115.04; 115B.17, subd. 4; and 116.091, and upon presentation of proper credentials, the agency, or an authorized employee or agent of the agency, shall be allowed by the Permittee to enter at reasonable times upon the property of the Permittee to examine and copy books, papers, records, or memoranda pertaining to the construction, modification, or operation of the facility covered by the permit or pertaining to the activity covered by the permit; and to conduct surveys and investigations, including sampling or monitoring, pertaining to the construction, modification, or operation of the facility covered by the permit or pertaining to the activity covered by the permit. (Minn. R. 7001.0150, subp.3, item I)

Chapter 8. Total Facility Requirements

1. General Requirements

- 1.13 Control Users. The Permittee shall regulate the users of its wastewater treatment facility so as to prevent the introduction of pollutants or materials that may result in the inhibition or disruption of the conveyance system, treatment facility or processes, or disposal system that would contribute to the violation of the conditions of this permit or any federal, state or local law or regulation.

Sampling

- 1.14 Representative Sampling. Samples and measurements required by this permit shall be conducted as specified in this permit and shall be representative of the discharge or monitored activity. (40 CFR 122.41 (j)(1))
- 1.15 Additional Sampling. If the Permittee monitors more frequently than required, the results and the frequency of monitoring shall be reported on the Discharge Monitoring Report (DMR) or another MPCA-approved form for that reporting period. (Minn. R. 7001.1090, subp. 1, item E)
- 1.16 Certified Laboratory. A laboratory certified by the Minnesota Department of Health shall conduct analyses required by this permit. Analyses of dissolved oxygen, pH, temperature, specific conductance, and total residual oxidants (chlorine, bromine) do not need to be completed by a certified laboratory but shall comply with manufacturers specifications for equipment calibration and use. (Minn. Stat. Sec. 144.97 through 144.98 and Minn. R. 4740.2010 and 4740.2050 through 4740.2120) (Minn. R. 4740.2010 and 4740.2050 through 2120)
- 1.17 Sample Preservation and Procedure. Sample preservation and test procedures for the analysis of pollutants shall conform to 40 CFR Part 136 and Minn. R. 7041.3200.
- 1.18 Equipment Calibration: Flow meters, pumps, flumes, lift stations or other flow monitoring equipment used for purposes of determining compliance with permit shall be checked and/or calibrated for accuracy at least twice annually. (Minn. R. 7001.0150, subp. 2, items B and C)
- 1.19 Maintain Records. The Permittee shall keep the records required by this permit for at least three years, including any calculations, original recordings from automatic monitoring instruments, and laboratory sheets. The Permittee shall extend these record retention periods upon request of the MPCA. The Permittee shall maintain records for each sample and measurement. The records shall include the following information (Minn. R. 7001.0150, subp. 2, item C):
- a. The exact place, date, and time of the sample or measurement;
 - b. The date of analysis;
 - c. The name of the person who performed the sample collection, measurement, analysis, or calculation; and
 - d. The analytical techniques, procedures and methods used; and
 - e. The results of the analysis.

Chapter 8. Total Facility Requirements

1. General Requirements

- 1.20 Completing Reports. The Permittee shall submit the results of the required sampling and monitoring activities on the forms provided, specified, or approved by the MPCA. The information shall be recorded in the specified areas on those forms and in the units specified. (Minn. R. 7001.1090, subp. 1, item D; Minn. R. 7001.0150, subp. 2, item B)

Required forms may include:

DMR Supplemental Form

Individual values for each sample and measurement must be recorded on the DMR Supplemental Form which, if required, will be provided by the MPCA. DMR Supplemental Forms shall be submitted with the appropriate DMRs. You may design and use your own supplemental form; however it must be approved by the MPCA.

Note: Required summary information MUST also be recorded on the DMR. Summary information that is submitted ONLY on the DMR Supplemental Form does not comply with the reporting requirements.

- 1.21 Submitting Reports. DMRs and Supplementals shall be submitted to:

MPCA

Attn: Discharge Monitoring Reports
520 Lafayette Road North
St. Paul, Minnesota 55155-4194.

DMRs, DMR supplemental forms and related attachments may be electronically submitted via the MPCA Online Services Portal after authorization is approved. When electronically submitted, the paper DMR submittal requirement is waived.

DMRs and DMR Supplemental Forms shall be postmarked or electronically submitted by the 21st day of the month following the sampling period or as otherwise specified in this permit. Electronic DMR submittal must be complete on or before 11:59 PM of the 21st day of the month following the sampling period or as otherwise specified in this permit. A DMR shall be submitted for each required station even if no discharge occurred during the reporting period. (Minn. R. 7001.0150, subs. 2.B and 3.H)

Other reports required by this permit shall be postmarked by the date specified in the permit to:

MPCA

Attn: WQ Submittals Center
520 Lafayette Road North
St. Paul, Minnesota 55155-4194

- 1.22 Incomplete or Incorrect Reports. The Permittee shall immediately submit an amended report or DMR to the MPCA upon discovery by the Permittee or notification by the MPCA that it has submitted an incomplete or incorrect report or DMR. The amended report or DMR shall contain the missing or corrected data along with a cover letter explaining the circumstances of the incomplete or incorrect report. (Minn. R. 7001.0150 subp. 3, item G)
- 1.23 Required Signatures. All DMRs, forms, reports, and other documents submitted to the MPCA shall be signed by the Permittee or the duly authorized representative of the Permittee. Minn. R. 7001.0150, subp. 2, item D. The person or persons that sign the DMRs, forms, reports or other documents must certify that he or she understands and complies with the certification requirements of Minn. R. 7001.0070 and 7001.0540, including the penalties for submitting false information. Technical documents, such as design drawings and specifications and engineering studies required to be submitted as part of a permit application or by permit conditions, must be certified by a registered professional engineer. (Minn. R. 7001.0540)

Chapter 8. Total Facility Requirements

1. General Requirements

1.24 Detection Level. The Permittee shall report monitoring results below the reporting limit (RL) of a particular instrument as "<" the value of the RL. For example, if an instrument has a RL of 0.1 mg/L and a parameter is not detected at a value of 0.1 mg/L or greater, the concentration shall be reported as "<0.1 mg/L." "Non-detected," "undetected," "below detection limit," and "zero" are unacceptable reporting results, and are permit reporting violations. (Minn. R. 7001.0150, subp. 2, item B)

Where sample values are less than the level of detection and the permit requires reporting of an average, the Permittee shall calculate the average as follows:

- a. If one or more values are greater than the level of detection, substitute zero for all nondetectable values to use in the average calculation.
 - b. If all values are below the level of detection, report the averages as "<" the corresponding level of detection.
 - c. Where one or more sample values are less than the level of detection, and the permit requires reporting of a mass, usually expressed as kg/day, the Permittee shall substitute zero for all nondetectable values. (Minn. R. 7001.0150, subp. 2, item B)
- 1.25 Records. The Permittee shall, when requested by the Agency, submit within a reasonable time the information and reports that are relevant to the control of pollution regarding the construction, modification, or operation of the facility covered by the permit or regarding the conduct of the activity covered by the permit. (Minn. R. 7001.0150, subp. 3, item H)
- 1.26 Confidential Information. Except for data determined to be confidential according to Minn. Stat. Sec. 116.075, subd. 2, all reports required by this permit shall be available for public inspection. Effluent data shall not be considered confidential. To request the Agency maintain data as confidential, the Permittee must follow Minn. R. 7000.1300.

Noncompliance and Enforcement

- 1.27 Subject to Enforcement Action and Penalties. Noncompliance with a term or condition of this permit subjects the Permittee to penalties provided by federal and state law set forth in section 309 of the Clean Water Act; United States Code, title 33, section 1319, as amended; and in Minn. Stat. Sec. 115.071 and 116.072, including monetary penalties, imprisonment, or both. (Minn. R. 7001.1090, subp. 1, item B)
- 1.28 Criminal Activity. The Permittee may not knowingly make a false statement, representation, or certification in a record or other document submitted to the Agency. A person who falsifies a report or document submitted to the Agency, or tampers with, or knowingly renders inaccurate a monitoring device or method required to be maintained under this permit is subject to criminal and civil penalties provided by federal and state law. (Minn. R. 7001.0150, subp.3, item G., 7001.1090, subps. 1, items G and H and Minn. Stat. Sec. 609.671)
- 1.29 Noncompliance Defense. It shall not be a defense for the Permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit. (40 CFR 122.41(c))

Chapter 8. Total Facility Requirements

1. General Requirements

1.30 Effluent Violations. If sampling by the Permittee indicates a violation of any discharge limitation specified in this permit, the Permittee shall immediately make every effort to verify the violation by collecting additional samples, if appropriate, investigate the cause of the violation, and take action to prevent future violations. If the permittee discovers that noncompliance with a condition of the permit has occurred which could endanger human health, public drinking water supplies, or the environment, the Permittee shall within 24 hours of the discovery of the noncompliance, orally notify the commissioner and submit a written description of the noncompliance within 5 days of the discovery. The written description shall include items a. through e., as listed below. If the Permittee discovers other non-compliance that does not explicitly endanger human health, public drinking water supplies, or the environment, the non-compliance shall be reported during the next reporting period to the MPCA with its Discharge Monitoring Report (DMR). If no DMR is required within 30 days, the Permittee shall submit a written report within 30 days of the discovery of the noncompliance. This description shall include the following information:

- a. a description of the event including volume, duration, monitoring results and receiving waters;
- b. the cause of the event;
- c. the steps taken to reduce, eliminate and prevent reoccurrence of the event;
- d. the exact dates and times of the event; and
- e. steps taken to reduce any adverse impact resulting from the event. (Minn. R. 7001.0150, subp. 3k)

1.31 Unauthorized Releases of Wastewater Prohibited. Except for conditions specifically described in Minn. R. 7001.1090, subp. 1, items J and K, all unauthorized bypasses, overflows, discharges, spills, or other releases of wastewater or materials to the environment, whether intentional or not, are prohibited. However, the MPCA will consider the Permittee's compliance with permit requirements, frequency of release, quantity, type, location, and other relevant factors when determining appropriate action. (40 CFR 122.41 and Minn. Stat. Sec 115.061)

Chapter 8. Total Facility Requirements

1. General Requirements

1.32 Discovery of a release. Upon discovery of a release, the Permittee shall:

- a. Take all reasonable steps to immediately end the release.
- b. Notify the Minnesota Department of Public Safety Duty Officer at 1(800)422-0798 or (651)649-5451 (metro area) immediately upon discovery of the release. You may contact the MPCA during business hours at 1(800)657-3864 or (651)296-6300 (metro area).
- c. Recover as rapidly and as thoroughly as possible all substances and materials released or immediately take other action as may be reasonably possible to minimize or abate pollution to waters of the state or potential impacts to human health caused thereby. If the released materials or substances cannot be immediately or completely recovered, the Permittee shall contact the MPCA. If directed by the MPCA, the Permittee shall consult with other local, state or federal agencies (such as the Minnesota Department of Natural Resources and/or the Wetland Conservation Act authority) for implementation of additional clean-up or remediation activities in wetland or other sensitive areas.
- d. Collect representative samples of the release. The Permittee shall sample the release for parameters of concern immediately following discovery of the release. The Permittee may contact the MPCA during business hours to discuss the sampling parameters and protocol. In addition, Fecal Coliform Bacteria samples shall be collected where it is determined by the Permittee that the release contains or may contain sewage. If the release cannot be immediately stopped, the Permittee shall consult with MPCA regarding additional sampling requirements. Samples shall be collected at least, but not limited to, two times per week for as long as the release continues.
- e. Submit the sampling results as directed by the MPCA. At a minimum, the results shall be submitted to the MPCA with the next DMR.

1.33 Upset Defense. In the event of temporary noncompliance by the Permittee with an applicable effluent limitation resulting from an upset at the Permittee's facility due to factors beyond the control of the Permittee, the Permittee has an affirmative defense to an enforcement action brought by the Agency as a result of the noncompliance if the Permittee demonstrates by a preponderance of competent evidence:

- a. The specific cause of the upset;
- b. That the upset was unintentional;
- c. That the upset resulted from factors beyond the reasonable control of the Permittee and did not result from operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventative maintenance, or increases in production which are beyond the design capability of the treatment facilities;
- d. That at the time of the upset the facility was being properly operated;
- e. That the Permittee properly notified the Commissioner of the upset in accordance with Minn. R. 7001.1090, subp. 1, item I; and
- f. That the Permittee implemented the remedial measures required by Minn. R. 7001.0150, subp. 3, item J.

Operation and Maintenance

Chapter 8. Total Facility Requirements

1. General Requirements

- 1.34 The Permittee shall at all times properly operate and maintain the facilities and systems of treatment and control, and the appurtenances related to them which are installed or used by the Permittee to achieve compliance with the conditions of the permit. Proper operation and maintenance includes effective performance, adequate funding, adequate operator staffing and training, and adequate laboratory and process controls, including appropriate quality assurance procedures. The Permittee shall install and maintain appropriate backup or auxiliary facilities if they are necessary to achieve compliance with the conditions of the permit and, for all permits other than hazardous waste facility permits, if these backup or auxiliary facilities are technically and economically feasible Minn. R. 7001.0150. subp. 3, item F.
- 1.35 In the event of a reduction or loss of effective treatment of wastewater at the facility, the Permittee shall control production or curtail its discharges to the extent necessary to maintain compliance with the terms and conditions of this permit. The Permittee shall continue this control or curtailment until the wastewater treatment facility has been restored or until an alternative method of treatment is provided. (Minn. R. 7001.1090, subp. 1, item C)
- 1.36 Solids Management. The Permittee shall properly store, transport, and dispose of biosolids, septage, sediments, residual solids, filter backwash, screenings, oil, grease, and other substances so that pollutants do not enter surface waters or ground waters of the state. Solids should be disposed of in accordance with local, state and federal requirements. (40 CFR 503 and Minn. R. 7041 and applicable federal and state solid waste rules)
- 1.37 Scheduled Maintenance. The Permittee shall schedule maintenance of the treatment works during non-critical water quality periods to prevent degradation of water quality, except where emergency maintenance is required to prevent a condition that would be detrimental to water quality or human health. (Minn. R. 7001.0150. subp. 3, item F and Minn. R. 7001.0150. subp. 2, item B)
- 1.38 Control Tests. In-plant control tests shall be conducted at a frequency adequate to ensure compliance with the conditions of this permit. (Minn. R. 7001.0150. subp. 3, item F and Minn. R. 7001.0150. subp. 2, item B)

Changes to the Facility or Permit

- 1.39 Permit Modifications. Except as provided under Minnesota Statutes, section 115.07, subdivisions 1 and 3, no person required by statute or rule to obtain a permit may construct, install, modify, or operate the facility to be permitted, nor shall a person commence an activity for which a permit is required by statute or rule until the agency has issued a written permit for the facility or activity. (Minn. R. 7001.0030)

Permittees that propose to make a change to the facility or discharge that requires a permit modification must follow Minn. R. 7001.0190. If the Permittee cannot determine whether a permit modification is needed, the Permittee must contact the MPCA prior to any action. It is recommended that the application for permit modification be submitted to the MPCA at least 180 days prior to the planned change.

Chapter 8. Total Facility Requirements

1. General Requirements

1.40 Construction. Construction may begin at the Permittee's own risk once the Permittee submits plans and specifications to the MPCA unless:

- a. the action taken is prohibited by federal law or regulation;
- b. the Permittee is a municipality constructing a wastewater system with a design flow of 0.200 million gallons per day or less;
- c. the action taken is subject to environmental review under chapter 116D, and prohibited from commencing construction until that process is completed;
- d. the action taken is subject to a grant or loan agreement under chapter 446A;
- e. the action taken requires a construction storm water permit under rules of the agency; or
- f. the action taken requires a subsurface sewage treatment system permit under rules of the agency.

In the cases specified in a. through f. above, no construction shall begin until the Permittee receives written approval of plans and specifications from the MPCA.

In all cases, the Permittee is prohibited from operating the system or discharging pollutants into the waters of the state until a written permit for the discharge is granted by MPCA and until plans and specifications for the disposal system have been approved, unless the MPCA waives the submission of plans and specifications. (Minn. Stat. 115.07, subd. 1 and 3)

1.41 Plans, specifications and MPCA approval are not necessary when maintenance dictates the need for installation of new equipment, provided the equipment is the same design size and has the same design intent. For instance, a broken pipe, lift station pump, aerator, or blower can be replaced with the same design-sized equipment without MPCA approval.

If the proposed construction is not expressly authorized by this permit, it may require a permit modification. If the construction project requires an Environmental Assessment Worksheet under Minn. R. 4410, no construction shall begin until a negative declaration is issued and all approvals are received or implemented.

1.42 Report Changes. The Permittee shall give advance notice as soon as possible to the MPCA of any substantial changes in operational procedures, activities that may alter the nature or frequency of the discharge, and/or material factors that may affect compliance with the conditions of this permit. (Minn. R. 7001.0150, subp. 3, item M)

Chapter 8. Total Facility Requirements

1. General Requirements

1.43 Chemical Additives. The Permittee shall receive prior written approval from the MPCA before increasing the use of a chemical additive authorized by this permit, or using a chemical additive not authorized by this permit, in quantities or concentrations that have the potential to change the characteristics, nature and/or quality of the discharge.

The Permittee shall request approval for an increased or new use of a chemical additive at least 60 days, or as soon as possible, before the proposed increased or new use.

This written request shall include at least the following information for the proposed additive:

- a. The process for which the additive will be used;
- b. Material Safety Data Sheet (MSDS) which shall include aquatic toxicity, human health, and environmental fate information for the proposed additive. The aquatic toxicity information shall include at minimum the results of: a) a 48-hour LC50 or EC50 acute study for a North American freshwater planktonic crustacean (either Ceriodaphnia or Daphnia sp.) and b) a 96-hour LC50 acute study for rainbow trout, bluegill or fathead minnow or another North American freshwater aquatic species other than a planktonic crustacean;
- c. A complete product use and instruction label;
- d. The commercial and chemical names and Chemical Abstract Survey (CAS) number for all ingredients in the additive (If the MSDS does not include information on chemical composition, including percentages for each ingredient totaling to 100%, the Permittee shall contact the supplier to have this information provided); and
- e. The proposed method of application, application frequency, concentration, and daily average and maximum rates of use. (Minn. R. 7001.0170)

1.44 Upon review of the information submitted regarding the proposed chemical additive, the MPCA may require additional information be submitted for consideration. This permit may be modified to restrict the use or discharge of a chemical additive and include additional influent and effluent monitoring requirements.

Approval for the use of an additive shall not justify the exceedance of any effluent limitation nor shall it be used as a defense against pollutant levels in the discharge causing or contributing to the violation of a water quality standard.

1.45 MPCA Initiated Permit Modification, Suspension, or Revocation. The MPCA may modify or revoke and reissue this permit pursuant to Minn. R. 7001.0170. The MPCA may revoke without reissuance this permit pursuant to Minn. R. 7001.0180.

1.46 TMDL Impacts. Facilities that discharge to an impaired surface water, watershed or drainage basin may be required to comply with additional permits or permit requirements, including additional restriction or relaxation of limits and monitoring as authorized by the CWA 303(d)(4)(A) and 40 CFR 122.44.1.2.i., necessary to ensure consistency with the assumptions and requirements of any applicable US EPA approved wasteload allocations resulting from Total Maximum Daily Load (TMDL) studies.

1.47 Permit Transfer. The permit is not transferable to any person without the express written approval of the Agency after compliance with the requirements of Minn. R. 7001.0190. A person to whom the permit has been transferred shall comply with the conditions of the permit. (Minn. R., 7001.0150, subp. 3, item N)

Chapter 8. Total Facility Requirements

1. General Requirements

1.48 Facility Closure. The Permittee is responsible for closure and postclosure care of the facility. The Permittee shall notify the MPCA of a significant reduction or cessation of the activities described in this permit at least 180 days before the reduction or cessation. The MPCA may require the Permittee to provide to the MPCA a facility Closure Plan for approval.

Facility closure that could result in a potential long-term water quality concern, such as the ongoing discharge of wastewater to surface or ground water, may require a permit modification or reissuance.

The MPCA may require the Permittee to establish and maintain financial assurance to ensure performance of certain obligations under this permit, including closure, postclosure care and remedial action at the facility. If financial assurance is required, the amount and type of financial assurance, and proposed modifications to previously MPCA-approved financial assurance, shall be approved by the MPCA. (Minn. Stat. Sec. 116.07, subd. 4)

1.49 Permit Reissuance. If the Permittee desires to continue permit coverage beyond the date of permit expiration, the Permittee shall submit an application for reissuance at least 180 days before permit expiration. If the Permittee does not intend to continue the activities authorized by this permit after the expiration date of this permit, the Permittee shall notify the MPCA in writing at least 180 days before permit expiration.

If the Permittee has submitted a timely application for permit reissuance, the Permittee may continue to conduct the activities authorized by this permit, in compliance with the requirements of this permit, until the MPCA takes final action on the application, unless the MPCA determines any of the following (Minn. R. 7001.0040 and 7001.0160):

- a. The Permittee is not in substantial compliance with the requirements of this permit, or with a stipulation agreement or compliance schedule designed to bring the Permittee into compliance with this permit;
- b. The MPCA, as a result of an action or failure to act by the Permittee, has been unable to take final action on the application on or before the expiration date of the permit;
- c. The Permittee has submitted an application with major deficiencies or has failed to properly supplement the application in a timely manner after being informed of deficiencies.

This checklist is intended to assist you in tracking the reporting requirements of your permit. However, it is only an aid. PLEASE CONSULT YOUR PERMIT FOR THE EXACT REQUIREMENTS.

Please note: This checklist only details submittal requirements for the next five years. DMRs, Annual Reports, and many other submittals are required even after the expiration date of this permit, and continue to be due until the permit is either reissued or terminated.

Submit DMRs to:

Attention: Discharge Monitoring Reports
Minnesota Pollution Control Agency
520 Lafayette Rd N
St. Paul, MN 55155

Submit other WQ reports to:

Attention: Submittals Center
Minnesota Pollution Control Agency
520 Lafayette Rd N
St. Paul, MN 55155

MPCA Staff Contacts:

For DMR-related questions:
Tamara Dahl at (507)476-4252
For other questions:
Ryan Swafford at (507)344-5253

2012

- Submit DMR (due before May 22)
Submit DMR (due before Jun 22)
Submit DMR (due before Jul 22)
Submit DMR (due before Aug 22)
Submit DMR (due before Sep 22)
Submit DMR (due before Oct 22)
Submit DMR (due before Nov 22)
Submit DMR (due before Dec 22)

2013

- Submit DMR (due before Jan 22)
Submit DMR (due before Feb 22)
Submit DMR (due before Mar 22)
Submit DMR (due before Apr 22)
Submit DMR (due before May 22)
Submit DMR (due before Jun 22)
Submit DMR (due before Jul 22)
Submit DMR (due before Aug 22)
Submit DMR (due before Sep 22)
Submit DMR (due before Oct 22)
Submit DMR (due before Nov 22)
Submit DMR (due before Dec 22)

2014

- Submit DMR (due before Jan 22)
Submit DMR (due before Feb 22)
Submit DMR (due before Mar 22)
Submit DMR (due before Apr 22)
Submit DMR (due before May 22)
Submit DMR (due before Jun 22)
Submit DMR (due before Jul 22)
Submit DMR (due before Aug 22)
Submit DMR (due before Sep 22)
Submit DMR (due before Oct 22)
Submit DMR (due before Nov 22)
Submit DMR (due before Dec 22)

2015

- Submit DMR (due before Jan 22)
Submit DMR (due before Feb 22)
Submit DMR (due before Mar 22)
Submit DMR (due before Apr 22)
Submit DMR (due before May 22)
Submit DMR (due before Jun 22)
Submit DMR (due before Jul 22)

Submittals and Actions Checklist Nerstrand WWTP

This checklist is intended to assist you in tracking the reporting requirements of your permit. However, it is only an aid. PLEASE CONSULT YOUR PERMIT FOR THE EXACT REQUIREMENTS.

Please note: This checklist only details submittal requirements for the next five years. DMRs, Annual Reports, and many other submittals are required even after the expiration date of this permit, and continue to be due until the permit is either reissued or terminated.

Submit DMRs to:

Attention: Discharge Monitoring Reports
Minnesota Pollution Control Agency
520 Lafayette Rd N
St. Paul, MN 55155

Submit other WQ reports to:

Attention: Submittals Center
Minnesota Pollution Control Agency
520 Lafayette Rd N
St. Paul, MN 55155

MPCA Staff Contacts:

For DMR-related questions:
Tamara Dahl at (507)476-4252
For other questions:
Ryan Swafford at (507)344-5253

2015

- Submit DMR (due before Aug 22)
- Submit DMR (due before Sep 22)
- Submit DMR (due before Oct 22)
- Submit DMR (due before Nov 22)
- Submit DMR (due before Dec 22)

2016

- Submit DMR (due before Jan 22)
- Submit DMR (due before Feb 22)
- Submit DMR (due before Mar 22)
- Submit DMR (due before Apr 22)
- Submit DMR (due before May 22)
- Submit DMR (due before Jun 22)
- Submit DMR (due before Jul 22)
- Submit DMR (due before Aug 22)
- Submit a Phosphorus Management Plan (due before Sep 1) (Permit Req't. 3.1.2)
- Submit an application for permit reissuance (due before Sep 1) (Permit Req't. 8.1.49)
- Submit DMR (due before Sep 22)
- Submit DMR (due before Oct 22)
- Submit DMR (due before Nov 22)
- Submit DMR (due before Dec 22)

2017

- Submit DMR (due before Jan 22)
- Submit DMR (due before Feb 22)

Other Submittals

- If, during any cropping year, biosolids were transferred, or not land applied, the Permittee shall submit a Biosolids Annual Report by December 31 following the end of the cropping year. The report shall state that biosolids were not land applied, how much was generated, and where they were transferred to. (Permit Req't. 6.9.2)

Salty Discharge Monitoring Customized Supplemental Report Form

Facility: Nerstrand WWTP

Permit #: MN0065668

Month:

Year:

DATE	Bicarbonates (mg/L)	Total Calcium (mg/L)	Total Chloride (mg/L)	Hardness as CaCO ₃ , Calcium & Magnesium (mg/L)	Total Magnesium (mg/L)	Total Potassium (mg/L)	Total Sodium as Na (mg/L)	Total Dissolved Solids (mg/L)	Specific Conductance (umh/cm)	Total Sulfate as SO ₄ (mg/L)	
	1										
2											
3											
4											
5											
6											
7											
8											
9											
10											
11											
12											
13											
14											
15											
16											
17											
18											
19											
20											
21											
22											
23											
24											
25											
26											
27											
28											
29											
30											
31											

Send with DMRs to: Discharge Monitoring Reports, MN Pollution Control Agency, 520 Lafayette Road North, St. Paul, MN 55155